


DO NOT SCALE

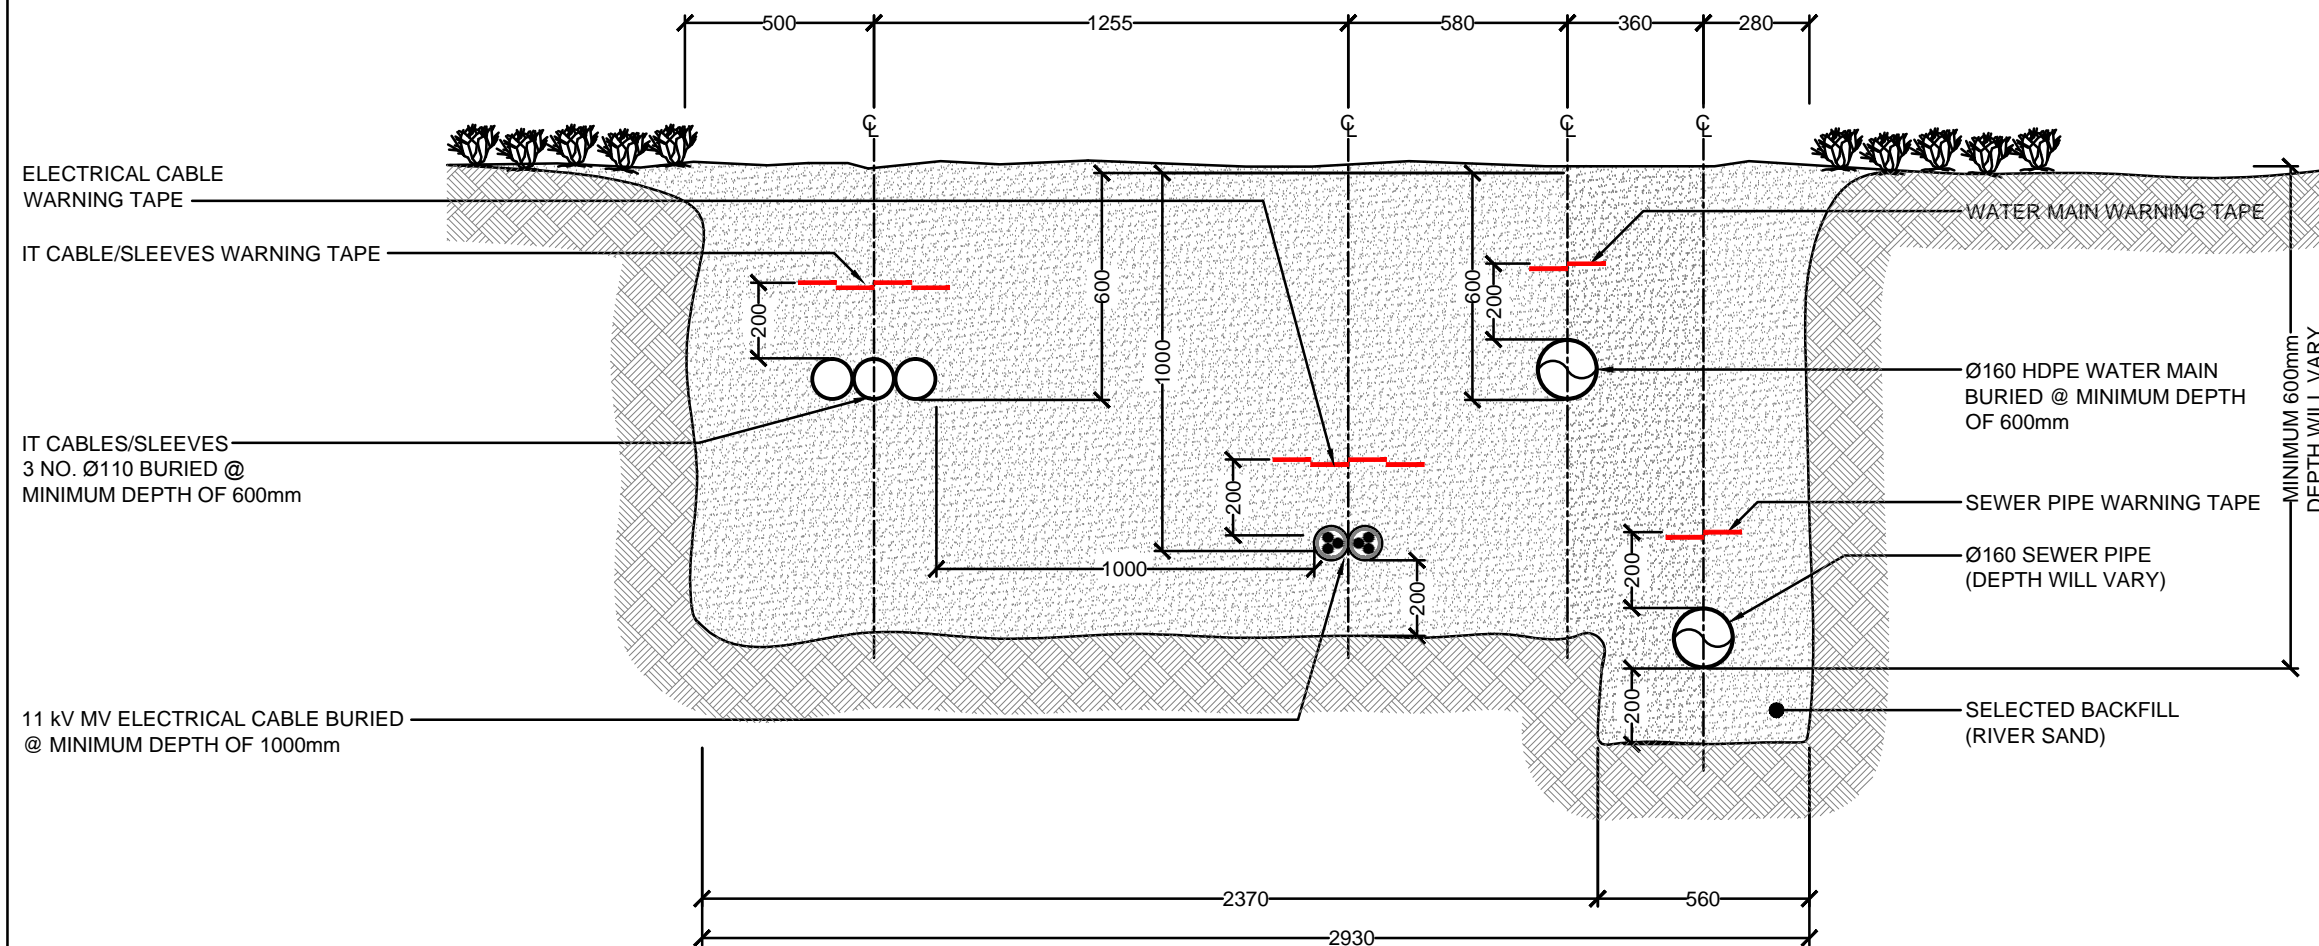

ELECTRICAL CABLE  
WARNING TAPE

IT CABLE/SLEEVES WARNING TAPE

IT CABLES/SLEEVES  
3 NO. Ø110 BURIED @  
MINIMUM DEPTH OF 600mm

11 kV MV ELECTRICAL CABLE BURIED  
@ MINIMUM DEPTH OF 1000mm

WATER MAIN WARNING TAPE

Ø160 HDPE WATER MAIN  
BURIED @ MINIMUM DEPTH  
OF 600mm

SEWER PIPE WARNING TAPE

Ø160 SEWER PIPE  
(DEPTH WILL VARY)

SELECTED BACKFILL  
(RIVER SAND)

MINIMUM 600mm  
DEPTH WILL VARY

**TYPICAL SECTION THROUGH TRENCH  
CO-ORDINATED SERVICES**

REV	DATE	BY	DESCRIPTION	CHK	APD
B	15.07.11	CM	UPDATED AS PER COMMENTS	LP	LP
A	13.07.11	CM	ISSUED FOR COMMENTS	LP	LP

DRAWING STATUS: PRELIMINARY



PO Box 98867 Sloane Park, 2152 South Africa  
Tel: +27 (0)11 361-1300 Fax: +27 (0)11 361-1301  
<http://www.wspgroup.co.za>

CLIENT: RADISSON BLU

ARCHITECT: CRONJE ASSOCIATED ARCHITECTS CC

PROJECT: RADISSON BLU  
SAFARI HOTEL - KRUGER NATIONAL PARK

TITLE: TYPICAL TRENCH DETAIL  
CO-ORDINATED SERVICES

SCALE @ A3: 1:20	CHECKED: LP	APPROVED: LP
CAD FILE: J5423/CO-ORDINATION	DESIGN-DRAWN: LP-CM	DATE: 13/07/2011
PROJECT No: J5423	DRAWING No: 9001	REV: B

P:\J5423 - Radisson Maléane\Drawings\9000 - Co-Ordination2 - Working Drawings\9001 (Rev B).dwg 15 Jul 2011 - 11:44am